


# SANITARY SEWER SERVICE LATERAL DETAIL

A MINIMUM 24-HOUR NOTICE IS REQUIRED PRIOR TO SCHEDULING AN INSPECTION

CONTRACTOR TO VERIFY  
WATER SERVICE LOCATION  
TO INSPECTOR

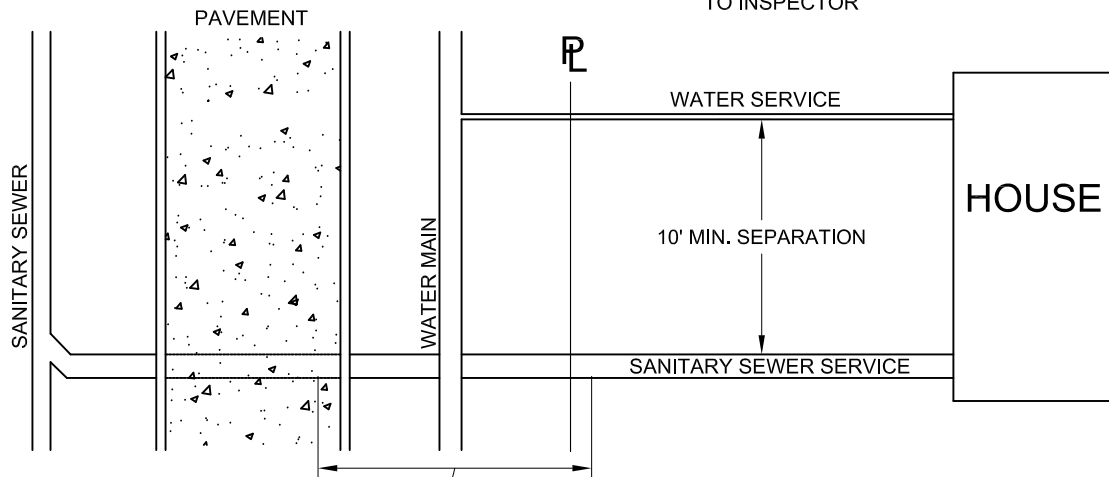

SERVICE MUST BE PVC  
SDR26 FOR TEN FEET  
ON EACH SIDE OF A  
WATER CROSSING

NOTES:

1. THE CONNECTION TO THE SEWER SHALL BE MADE WITH A "WYE" OR SEWER TAP, AS WITNESSED BY THE INSPECTOR.  
**ALL COUPLINGS USED SHALL BE OF A NON-SHEAR TYPE.**


2. THE SLOPE OF THE SERVICE LINE SHALL BE NO LESS THAN 1/8" PER FOOT

3. THERE SHALL BE A MINIMUM COVER OF 4 FEET.

4. CLEAN OUT RISER SHALL BE SAME DIAMETER AS SEWER SERVICE LATERAL PIPE.



4' MIN.




SANITARY SEWER

STREET OR SIDEWALK CROSSING  
TRENCHES TO HAVE COMPACTED  
APPROVED GRANULAR BACKFILL  
PLACED TO SURFACE.

SEE STREET CUT REPAIR  
SPECIFICATIONS FOR PAVEMENT  
REPAIR.

GREEN (NON-TRAFFIC)  
AREAS TO HAVE  
CLEAN FILL PLACED  
TO SURFACE

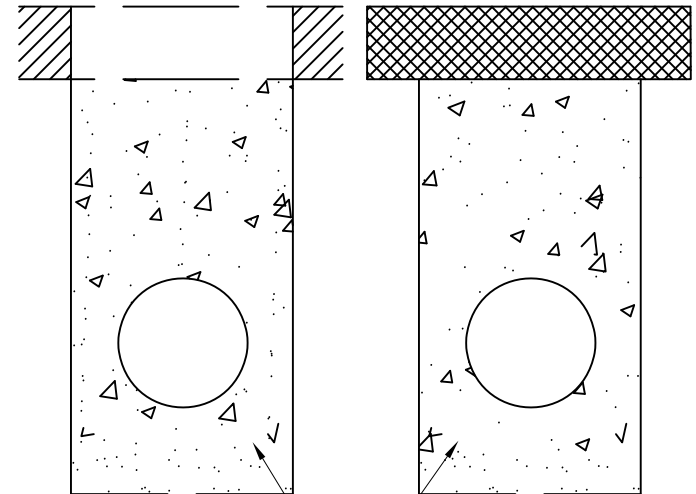

FILL PER STANDARD  
SPECIFICATIONS FOR  
WATER AND SEWER  
MAIN CONSTRUCTION  
IN ILLINOIS

CITY OF WHEATON	
DESIGN DETAILS AND STANDARDS	
FIGURE # 15	
DATE: 03-15-16	FILE NAME: Sanitary Service Lateral Detail.dwg